


NOTES

1. COVER PAVEMENT CUTS WITH STEEL PLATES OF SUFFICIENT THICKNESS TO SPAN THE CUT AND SAFELY CARRY TRAFFIC.
2. USE READY-MIX CONCRETE WITH 4,000 PSI STRENGTH @ 28 DAYS.
3. COMPLY WITH SPECIFIC REQUIREMENTS OF APPLICABLE DOT UTILITY ENCROACHMENT PERMITS.

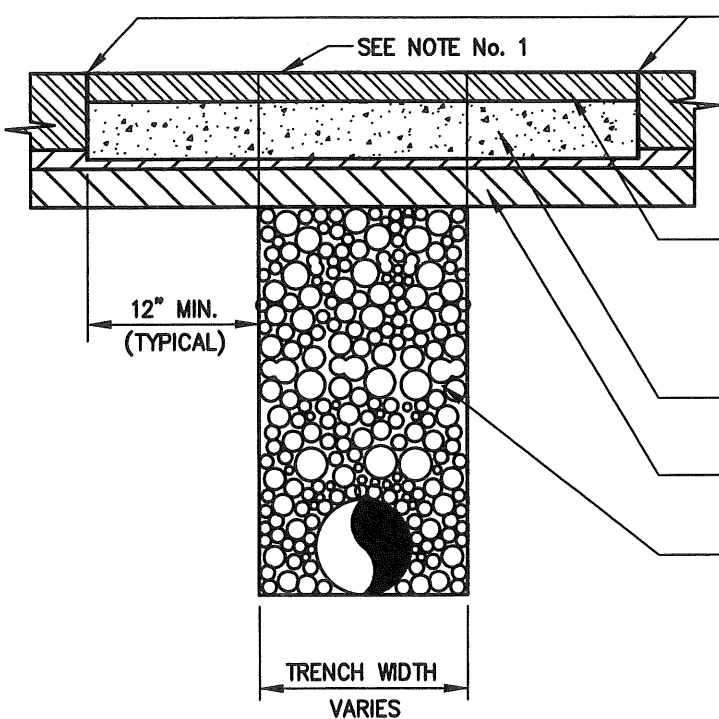

PAVEMENT CUTS SHALL COMPLY WITH GA. D.O.T. STANDARD SPECS., SECTION 444 "SAWED JOINTS IN EXISTING PAVEMENTS". SAW PAVEMENT WITH NEAT LINES 9" ON EACH SIDE OF TRENCH OR TO VISIBLE OVERBREAK, WHICHEVER IS GREATER.

REPLACE TOP 2" WITH SAME TYPE MATERIAL AS EXISTING SURFACE. CLEAN SURFACES AND APPLY BITUMINOUS TACK COAT OR PRIME BEFORE PLACEMENT OF ASPHALT TOP.

CONCRETE (8" MINIMUM)

REPLACE SUB-BASE AND SUB-GRADE AS DIRECTED BY D.O.T.

COMPACT CRUSHED STONE.

D.O.T. PAVEMENT REPLACEMENT

NTS



LUMPKIN COUNTY WSA
194 COURTHOUSE HILL
DAHLONEGA, GA 30533
TEL. (706) 867-6580

**WATER SYSTEM IMPROVEMENTS
STANDARD DETAILS**

DRAWN BY: SMS

SCALE: AS SHOWN

DATE: JULY 13, 2019

DWG. NO. 494-03A1-W11