


NOTES

1. USE READY-MIX CONCRETE WITH 3,000 PSI STRENGTH @ 28 DAYS.
2. PLACE CONCRETE BEARING SURFACES AGAINST UNDISTURBED EARTH.
3. PLACE CONCRETE CLEAR OF JOINT AND JOINT ACCESSORIES.

PIPE SIZE	90° BEND A	45° BEND A	22.5° BEND A	11.25° BEND A	TEES A	PLUGS A B	
4"	15"	12"	12"	12"	12"	12"	10"
6"	20"	16"	12"	12"	18"	18"	12"
8"	30"	20"	15"	12"	24"	24"	12"
10"	36"	26"	18"	14"	30"	30"	14"
12"	40"	32"	20"	16"	36"	36"	16"
14"	48"	36"	26"	18"	40"	40"	18"
16"	64"	42"	32"	20"	48"	48"	20"

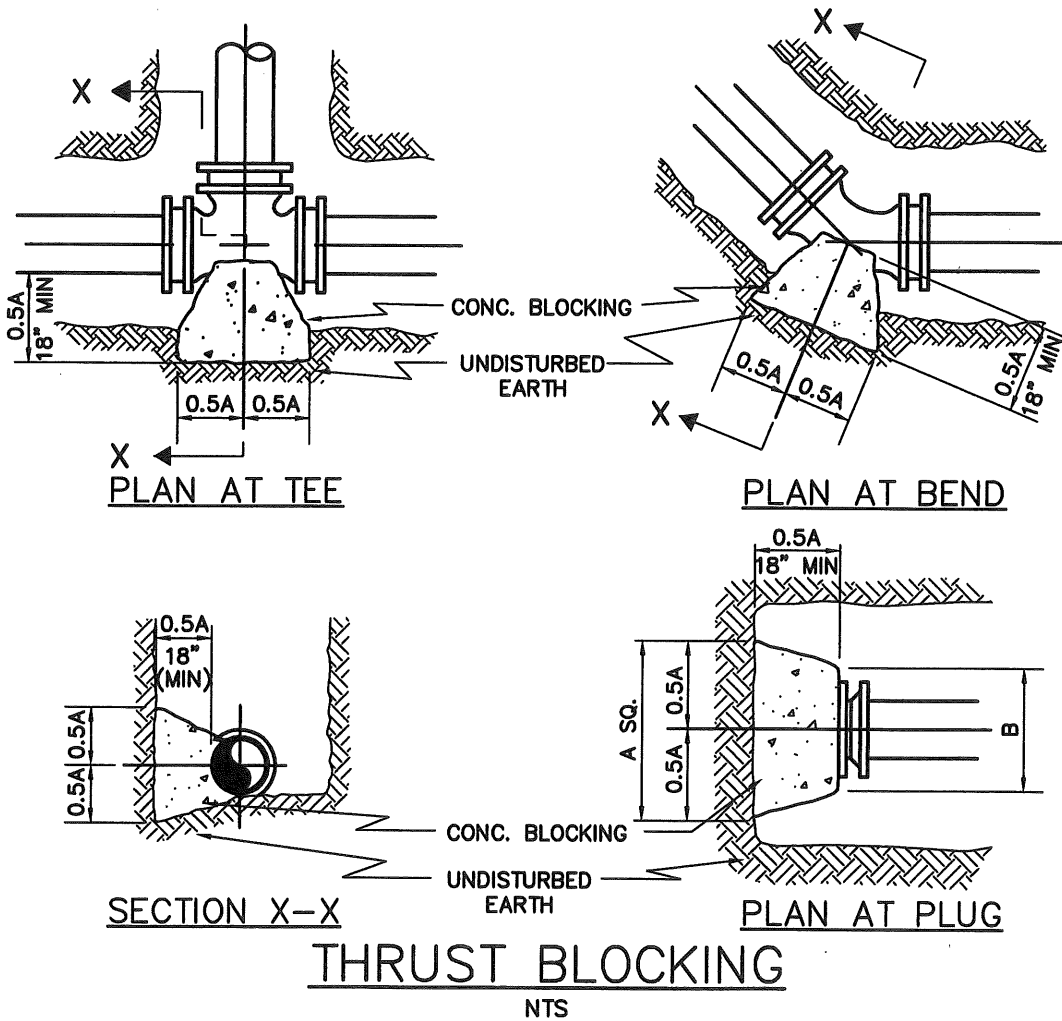

LUMPKIN COUNTY WSA
194 COURTHOUSE HILL
DAHLONEGA, GA 30533
TEL. (706) 867-6580

**WATER SYSTEM IMPROVEMENTS
STANDARD DETAILS**